



# EA19D

# **DUAL MOVING-IRON METER AC Ammeter and Voltmeter**

## **APPLICATION**

The panel electromagnetic meter with a double measuring system is designed to measure AC current with a frequency of 15 ... 400 Hz and a voltage of 15 ... 100 Hz. The meter will be used, among others, in switchgears, control cabinets of generators and wherever there is a limited space for measuring two electrical quantities.

EA19D meters are designed for mounting into panels with thickness not exceeding 25 mm in the holes 92 x 92 mm.

#### **TECHNICAL DATA**

**Accuracy class** 1.5 Measuring ranges, self-consumption,

front frame dimensions,

length of scale, weight acc. to tab. 1, 2

Rated operating conditions:

- ambient temperature 5...23...55°C - relative air humidity 25...85% - frequency of measured quantity

for In: 15...400Hz

for Un: 15...100Hz

**Execution of ammeters** normal scale version or version with 100% overload. Other overcurrent

scale, on request after agreement.

Additional errors according to EN 60051-2

Execution of ammeters with the nominal range scale according to table 1; or an extended scale with a value of 2- or 6-times overload or another agreed with the manufacturer.

Categories of meter climatic versions

If it is not written otherwise in the order, these meters are intended to use in moderate climatic conditions.

On customers' request, meters can be adapted to use in conditions of a dry or wet tropical climat.

Then, they are marked with the T III symbol.

### Requirements concerning safety acc.EN 61010-1 standard:

- installation category Ш - pollution degree 2

- maximal phase-earth

working voltage 600 V

#### **Electromagnetic Compatibility:**

- meters meet requirements CE mark

- noise immunity acc. to EN 61000-6-2 - noise emissions acc. to EN 61000-6-4 The power consumed by the meter

- voltage circuit: < 4.5 VA - current circuit for In<15A: < 0.5 VA - current circuit for In>15A: < 0.8 VA

Masa

EA19D 200 g

**Electrical overload:** 

120% In. 120% Un - long-term - short-time current measurement 10 times for 5s 2 times for 5s - short-term voltage measurement (max. 1000V)

Impact resistance

- peak acceleration 15 a - duration of impact 11 ms

Shock resistance

10-55-10Hz - range of vibration frequency - vibration amplitude 0.15 mm

(corresponds to 1.5 g at 50 Hz)

# Protection Grade acc. to EN 60529

ensureb by:

IP 52 - case: standard custom-made **IP 65** IP 20 - terminals

Case material thermoplastic material,

self-extinguishing plastic (UL 94V-O)

glass, plastic or anti-reflective glass Meter glass material

(acc. to ordering code)

#### **ACCESSORIES**

Screw holders - 2 pcs.

#### Additional setting pointer

On customers' request EA19D meters can be equiped with an additional, setting red pointer fixed on the glass.



# AC CURRENT AND AC VOLTAGE DIRECT MEASUREMENT RANGES


Table 1

| Item | Measuring range | Code | Item | Measuring range | Code | Item | Measuring range | Code |  |
|------|-----------------|------|------|-----------------|------|------|-----------------|------|--|
| 1.   | 1A              | 01   | 21.  | 69.24V          | 2F   | 41.  | 143.5V          | 3B   |  |
| 2.   | 1.04A           | 02   | 22.  | 75V             | 2G   | 42.  | 149.85V         | 3C   |  |
| 3.   | 1.08A           | 03   | 23.  | 79.375V         | 2H   | 43.  | 150V            | 3D   |  |
| 4.   | 1.083A          | 04   | 24.  | 100V            | 2J   | 44.  | 159V            | 3E   |  |
| 5.   | 1.125A          | 05   | 25.  | 110V            | 2K   | 45.  | 160V            | 3F   |  |
| 6.   | 1.2A            | 06   | 26.  | 113.63V         | 2L   | 46.  | 165V            | 3G   |  |
| 7.   | 1.266A          | 07   | 27.  | 116.66V         | 2M   | 47.  | 220V            | 3H   |  |
| 8.   | 1.5A            | 08   | 28.  | 116.67V         | 2N   | 48.  | 230V            | 3J   |  |
| 9.   | 5A              | 09   | 29.  | 119.56V         | 2P   | 49.  | 239.42V         | 3K   |  |
| 10.  | 10A             | 10   | 30.  | 120V            | 2Q   | 50.  | 250V            | 3L   |  |
| 11.  | 20A             | 11   | 31.  | 121.21V         | 2R   | 51.  | 300V            | 3M   |  |
| 12.  | 30A             | 12   | 32.  | 123.75V         | 2S   | 52.  | 380V            | 3N   |  |
| 13.  | 40A             | 13   | 33.  | 125V            | 2T   | 53.  | 400V            | 3P   |  |
| 14.  | 50A             | 14   | 34.  | 130V            | 2U   | 54.  | 415V            | 3Q   |  |
| 15.  | 60A             | 15   | 35.  | 130.43V         | 2V   | 55.  | 480V            | 3R   |  |
| 16.  | 20V             | 2A   | 36.  | 132V            | 2W   | 56.  | 500V            | 3S   |  |
| 17.  | 30V             | 2B   | 37.  | 132.5V          | 2X   | 57.  | 550V            | 3T   |  |
| 18.  | 57.7V           | 2C   | 38.  | 133.33V         | 2Y   | 58.  | 600V            | 3U   |  |
| 19.  | 57.8V           | 2D   | 39.  | 137.5V          | 2Z   | 59.  | 175V            | 3V   |  |
| 20.  | 63.5V           | 2E   | 40.  | 139.68V         | 3A   | 60.  | XX <sup>1</sup> | XX   |  |

<sup>&</sup>lt;sup>1</sup> after agreeing with the manufacturer

# **ELECTRICAL CONNECTION**


AC Voltage (Direct connected)



N(L2)\_\_\_



## **EXTERNAL DIMENSIONS**






Fig. 1. External dimensions of EA19D [mm].

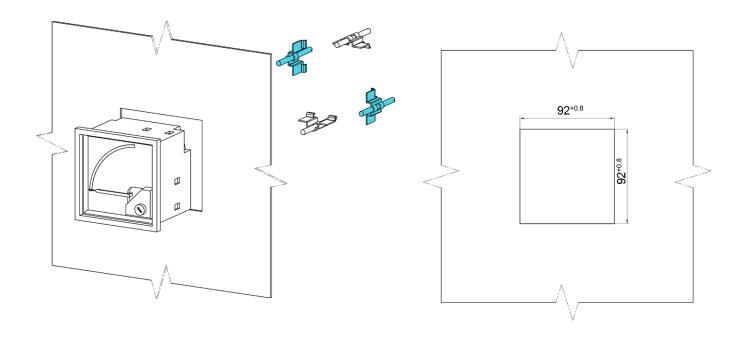


Fig. 2. Panel mounting way of EA19D (version IP52)\*



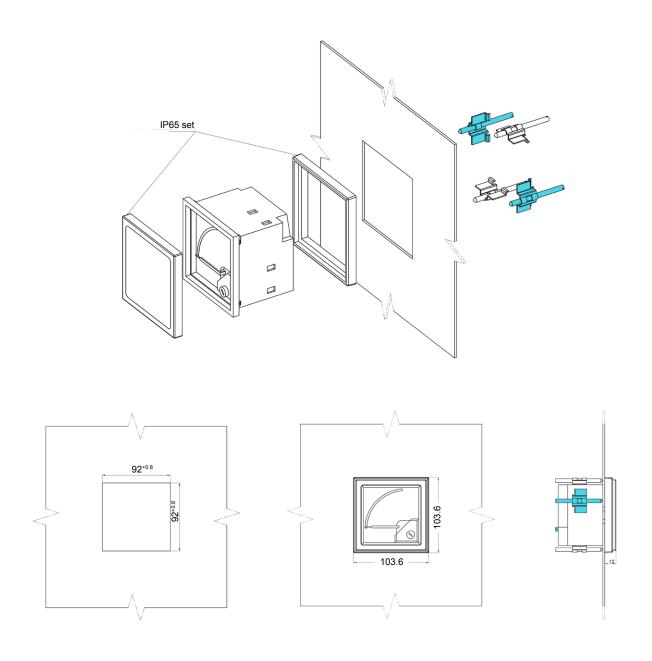


Fig. 3. Panel mounting way of EA19D (version IP65) \*

<sup>\*</sup> Included are 2 screwdrivers. Use them on two opposite sides of the meter.



### **ORDERING CODE**

|                   | Dual Moving Iron Movement Meter EA19D                 | Х | XX | XX | Х | Х | Х | Х | Α | В | Х | Х |
|-------------------|---|---|----|----|---|---|---|---|---|---|---|---|
|                   | Current Meter   | I |    |    |   |   |   |   |   |   |   |   |
| Input Type        | Voltage Meter   |   |    |    |   |   |   |   |   |   |   |   |
|                   | Current -Voltage Meter B                              |   |    |    |   |   |   |   |   |   |   |   |
| Measuring Range 1 | write in the range code from the table 1 <sup>1</sup> |   | XX |    |   |   |   |   |   |   |   |   |
| Measuring Range 2 | write in the range code from the table 1 <sup>1</sup> |   |    | XX |   |   |   |   |   |   |   |   |
|                   | x1 <sup>2</sup>                                       |   |    |    | 1 |   |   |   |   |   |   |   |
| 0                 | x2 <sup>2</sup>                                       |   |    |    | 2 |   |   |   |   |   |   |   |
| Suppression       | x6 <sup>2, 4</sup>                                    |   |    |    | 6 |   |   |   |   |   |   |   |
|                   | not applicable <sup>3</sup>                           |   |    |    | Χ |   |   |   |   |   |   |   |
| Acquirocy Close   | 1.5   |   |    |    |   | 1 |   |   |   |   |   |   |
| Accuracy Class    | 1 <sup>3</sup>  |   |    |    |   | 2 |   |   |   |   |   |   |
|                   | Normal Glass  |   |    |    |   |   | Α |   |   |   |   |   |
| Front Facia       | Plastic Front facia <sup>4</sup>                      |   |    |    |   |   | Р |   |   |   |   |   |
|                   | Antiglare Glass <sup>4</sup>                          |   |    |    |   |   | N |   |   |   |   |   |
| Back Cover        | With Back cover                                       |   |    |    |   |   |   | С |   |   |   |   |
|                   | Without Back cover <sup>4</sup>                       |   |    |    |   |   |   | В |   |   |   |   |
| Type of dial      | Standard Aluminum                                     |   |    |    |   |   |   |   | Α |   |   |   |
| Screw holders     | included  |   |    |    |   |   |   |   |   | В |   |   |
| Language          | Polish-English  |   |    |    |   |   |   |   |   |   | M |   |
|                   | without additional quality requirements               |   |    |    |   |   |   |   |   |   |   | 0 |
| Acceptance tests  | with an extra quality inspection certifi cate         |   |    |    |   |   |   |   | 1 |   |   |   |
|                   | with a calibration certificate                        |   |    |    |   |   |   |   |   |   |   | 2 |

<sup>&</sup>lt;sup>1</sup> In the case of a measurement from a current or voltage transformer, the transformer ratio must additionally be specified in the order and the range corresponding to the secondary side of the transformer should be selected in the code.



www.lumel.com.pl

<sup>&</sup>lt;sup>2</sup> only in the meter execution EA19DI and EA19DB

<sup>&</sup>lt;sup>3</sup> only in the meter execution EA19DV

<sup>&</sup>lt;sup>4</sup> limited availability, needs to be agreed with the manufacturer