




## ND30PNET - METER OF POWER NETWORK PARAMETERS WITH PROFINET

- Measurement of 54 power network parameters, including **current and voltage harmonics up to 51st**, in 1-phase 2-wire or 3-phase 3 or 4-wire balanced and unbalanced systems.
- **High accuracy class (0.2S for active energy).**
- **Graphical color display:** LCD TFT 3,5", 320 x 240 pixels, **fully configurable by a user** (10 views, 8 parameters in each).
- Indications include the values of programmed ratios.
- Memory of minimum and maximum values.
- 2 configurable alarm outputs.
- Optional: analog output 0/4...20 mA and 2 PT 100 inputs (eg. for measurement of transformer temperature).
- Digital output RS-485 - MODBUS protocol.
- **Modern and user-friendly Ethernet/Profinet (version 2.2.) interface.**
- Programming of parameters using **free eCon software**.
- Battery backup RTC.
- Overall dimensions: 96 x 96 x 77 mm.

### EXAMPLE OF APPLICATION

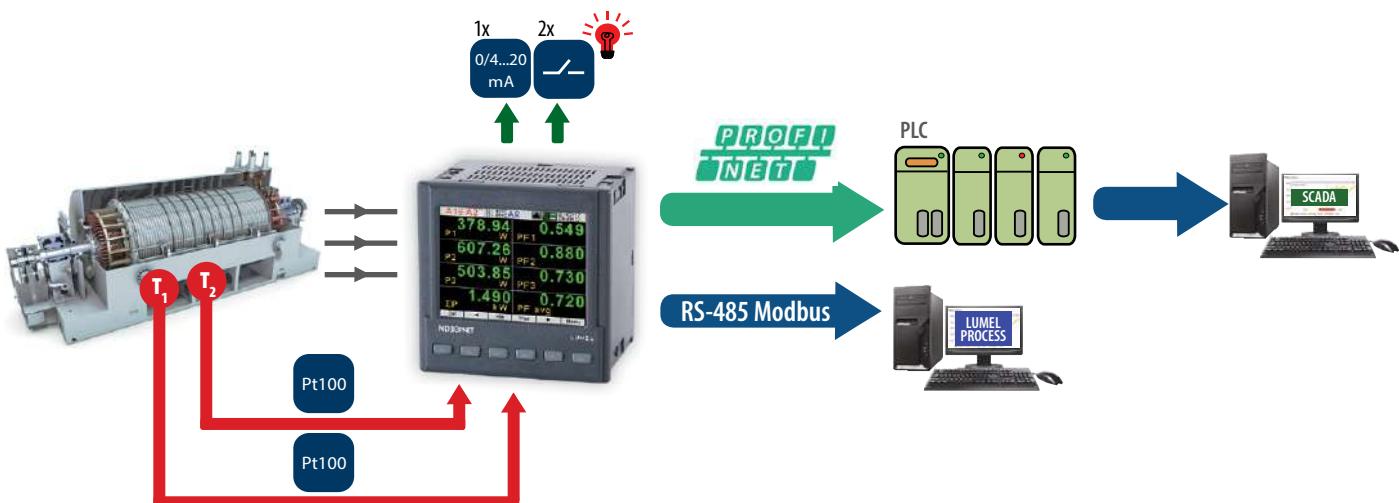

### MEASUREMENT AND VISUALIZATION OF POWER NETWORK PARAMETERS

- phase voltages:  $U_1, U_2, U_3$
- phase-to-phase voltages:  $U_{12}, U_{23}, U_{31}$
- phase currents  $I_1, I_2, I_3$
- active phase powers:  $P_1, P_2, P_3$
- reactive phase powers:  $Q_1, Q_2, Q_3$
- apparent phase powers:  $S_1, S_2, S_3$
- active power factors:  $PF_1, PF_2, PF_3$
- reactive/active power factors:  $\text{tg}\varphi_1, \text{tg}\varphi_2, \text{tg}\varphi_3$
- active, reactive and apparent 3-phase power:  $P, Q, S$
- mean 3-phase power factors:  $PF, \text{tg}\varphi$
- frequency  $f$
- mean 3-phase voltage:  $U_s$
- mean phase-to-phase voltage:  $U_{mf}$
- mean 3-phase current:  $I_s$
- 15, 30, 60 minutes' mean active power:  $P_{\text{demand}}$
- mean apparent power  $S_{\text{demand}}$
- average current  $I_{\text{demand}}$
- active, reactive and apparent 3-phase energy:  $EnP, EnQ, EnS$
- active, reactive and apparent energy from external counter:  $EnPE$
- total harmonic content coefficients for phase voltages and currents  $\text{THD}_{U1}, \text{THD}_{U2}, \text{THD}_{U3}, \text{THD}_{I1}, \text{THD}_{I2}, \text{THD}_I$  and for 3-phase voltages and currents  $\text{THD}_U, \text{THD}_I$
- harmonics for current and phase voltage up to 51 st!
- temperature (2 x Pt100 input)

FEATURES	INPUTS	OUTPUTS	GALVANIC ISOLATION
     	 	   	        

## TECHNICAL DATA

### MEASURING RANGE

Measured value	Measuring range	L1	L2	L3	$\Sigma$	Class
Current 1/5 A 1 A~ 5 A~	0.002 ..0.100..1.200 A 0.010 ..0.500.. 6.000 A ...100.000 kA (tr <sub>I</sub> ≠1)	.	.	.		0.2 (EN 61557-12)
Voltage L-N 57.7 V~ 110 V~ 230 V~ 400 V~	5.700..11.500..70.000 V 11.000..22.000..132.00 V 23.000..46.000 .. 276.00 V 40.000..80.000 .. 480.00 V ...1920.0 kV	.	.	.		0.2 (EN 61557-12)
Voltage L-L 100 V~ 190 V~ 400 V~ 690 V~	10.000 ..20.000..120.00 V 19.000 ..38.000..228.00 V 40.000..80.00 .. 480.00 V 69.000..138.00 .. 830.00 V ...1999.0 kV (tr <sub>U</sub> ≠1)	.	.	.		0.5 (EN 61557-12)
Active power P	-19999 MW .. 0,000 W .. .19999 MW (tr <sub>U</sub> ≠1,tr <sub>I</sub> ≠1)	.	.	.	.	0.5 (EN 61557-12)
Reactive power Q	-19999 MVar .. 0,000 Var .. .19999 MVar (tr <sub>U</sub> ≠1,tr <sub>I</sub> ≠1)	.	.	.	.	1 (EN 61557-12)
Apparent power S	0.000 .. 1999.9 VA .. .19999 MVA (tr <sub>U</sub> ≠1,tr <sub>I</sub> ≠1)	.	.	.	.	0.5 (EN 61557-12)
<b>Active energy EnP (imported or exported)</b>	0.000 .. 99 999 999.999 kWh				.	<b>0.25 (EN 62053-22)</b>
Reactive energy EnQ (inductive or capacitive)	0.000 .. 99 999 999.999 kWh				.	1 (EN 61557-12)
Apparent energy EnS	0.000 .. 99 999 999.999 kWh				.	0.5 (EN 61557-12)
Active power factor PF	-1.00 ..0..1.00	.	.	.	.	1 (EN 61557-12)
Coefficient tg (ratio of reactive power to active power)	-999.99...-1.20 .. 0 .. 1.20..999.99	.	.	.	.	1
Frequency f	45.00..65.00...100.00 Hz				.	0.1 (EN 61557-12)
Total harmonic distortion of voltage THDV and current THDI	0.0..100.0 %	.	.	.	.	5 (EN 61557-12)
Amplitudes of the voltage $U_{h2}..U_{h51}$ and current $I_{h2} \dots I_{h51}$	0.0..100.0 %	.	.	.		II (IEC61000-4-7)

tr<sub>I</sub> - Current transformer ratio = Primary current of the transformer / Current of the current transformer,  
tr<sub>U</sub> - Transmission of voltage transformer = Primary voltage of the transformer / Secondary voltage of the voltage transformer

### ADDITIONAL INPUTS

Input type	Properties
Input Pt100 (T1, T2) - option	2 x Pt100, 2-wire, -50..400°C, basic error 0.5 %
Binary inputs - option	0V d.c. – binary input inactive, 5...24V d.c. – binary input active

### DIGITAL INTERFACE

Interface type	Transmission protocol	Remarks
RS-485	Modbus RTU 8N2,8E1,8O1,8N1	Address 1..247 baud rate: 4.8, 9.6, 19.2, 38.4, 57.6, 115.2 kbit/s
Ethernet / Profinet	ICMP (Ping) / Profinet version 2.2	

## EXTERNAL FEATURES

Readout field	graphic color display LCD TFT 3,5", 320 x 240 pixels	
Overall dimensions	96 x 96 x 77 mm	mounting hole 92.5 x 92.5 mm
Weight	0.3 kg	
Protection grade	from frontal side: IP65	from terminal side: IP20


## RATED OPERATING CONDITIONS

Supply voltage	→ 85...253 V a.c. (40...50...400 Hz), 90...300 V d.c. or 20...40 V a.c., 20...60 V d.c.	power consumption ≤ 6 VA
Power consumption	in voltage circuit ≤ 0.2 VA	in current circuit ≤ 0.1 VA
Input signal	0...0.1...1.2 In; 0.1...0.2...1.2 Un for current, voltage, PF, tgφ	frequency 45...50...60...100 Hz, sinusoidal (THD ≤ 8%)
Power factor	-1...0...1	
Preheating time	5 min.	
Ambient temperature	-10...23...55°C, class K55 acc. to EN61557-12	
Humidity	0...40...65...95%	without condensation
Operating position	any	
External magnetic field	≤ 40...400 A/m d.c.	≤ 3 A/m a.c. 50/60 Hz
Short-term overload	voltage input: 2 Un (5 sec.)	current input 50 A (1 sec.)
Admissible crest factor	current: 2	voltage: 2
Additional error (in % of the intrinsic error)		from ambient temperature change: < 50% / 10°C


## SAFETY AND COMPABILITY REQUIREMENTS

Electromagnetic compatibility	noise immunity noise emissions	acc. to EN 61000-6-2 acc. to EN 61000-6-4
Isolation insured by the casing	double	acc. to EN 61010-1
Isolation between circuits	basic	acc. to EN 61010-1
Polution level	2	acc. to EN 61010-1
Installation category	III	acc. to EN 61010-1
Maximal phase-to-earth voltage	• for supply circuit and relay outputs 300 V • for measuring input 500 V • for circuits of RS-485, Ethernet, pulse input and output, analog outputs, temperature or binary inputs: 50 V	acc. to EN 61010-1
Altitude a.s.l.	< 2000 m	

## CONNECTION DIAGRAMS

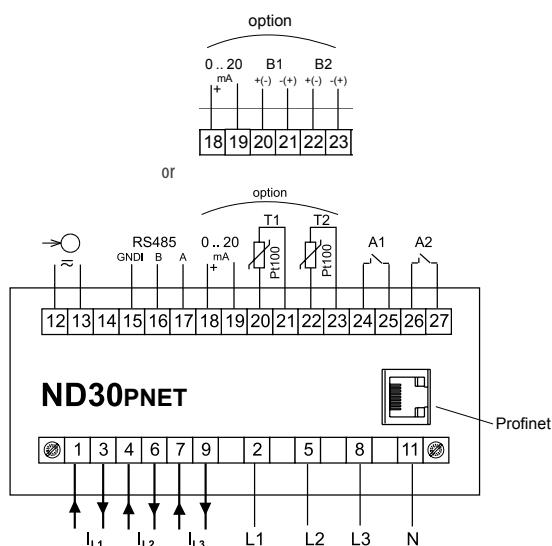

Description of meter connections strips

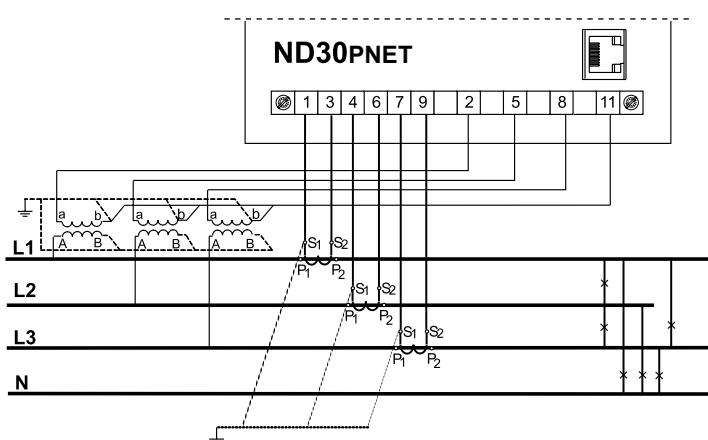

Indirect measurement in 4-wire network - connection of input signals



## DISPLAYING OF MEASUREMENT PARAMETERS

A1	A2	T1: 52°C T2: 31°C	TX	15/03/16 11:33:16
<b>225.48</b>			<b>1.005</b>	
U1	V	I1	A	
<b>228.91</b>		<b>2.105</b>		
U2	V	I2	A	
<b>231.22</b>		<b>1.805</b>		
U3	V	I3	A	
<b>49.999</b>		<b>1.638</b>		
f	Hz	I avg	A	
Del	<	Min	Max	► Menu

A1	A2	T1: 131°C T2: 329°C	TX	15/03/16 13:04:26
<b>843.80</b>		<b>21 660 807.201</b>		
ΣP	W	En P+ kWh		
<b>726.01</b>		<b>2 786 343.635</b>		
ΣQ	var	En P- kWh		
<b>1.126</b>		<b>13 760.862</b>		
ΣS	kVA	En Q kvarh		
24 853 934.200		12 035.698		
En S kVAh		En Q± kvarh		
Del	<	Min	Max	► Menu


A1	A2	T1: 52°C T2: 37°C	TX	15/03/16 12:02:57
<b>225.48</b>		<b>226.57</b>		
U1	V	S1	VA	
<b>1.005</b>		<b>0.913</b>		
I1	A	PF1		
<b>206.88</b>		<b>0.447</b>		
P1	W	tg1		
<b>92.387</b>		<b>49.999</b>		
Q1	var	f	Hz	
Del	<	Min	Max	► Menu

A1	A2	T1: 49°C T2: 53°C	TX	22/09/15 13:36:31
<b>0.905</b>		<b>0.905</b>		
U1	%	I1	%	
<b>0.905</b>		<b>0.903</b>		
U2	%	I2	%	
<b>0.903</b>		<b>0.903</b>		
U3	%	I3	%	
<b>Har. 5</b>				
50160	<	▼	▲	► Menu

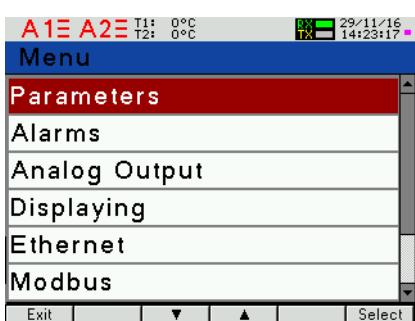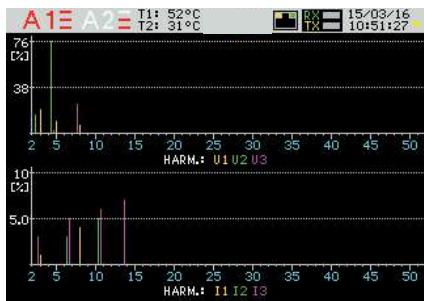

up to 10 programmable screens  
(8 parameters per page);  
ability to change color for all screens

Available colors for digital indications:

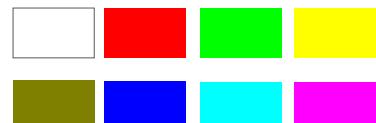


two screens dedicated to harmonics;  
indication of individual harmonic  
for voltages and currents (up to 51st);  
bargraph presentation for all harmonics  
with zoom function

easy to use and intuitive menu;  
information bar with status of: phase  
sequence, alarm outputs, temperature  
measurements, binary inputs\*  
and RS-485 interfaces,  
time and date

\*- availability of feature depends on  
hardware version of ND30PNET

## METER CONFIGURATION WITH FREE eCON SOFTWARE

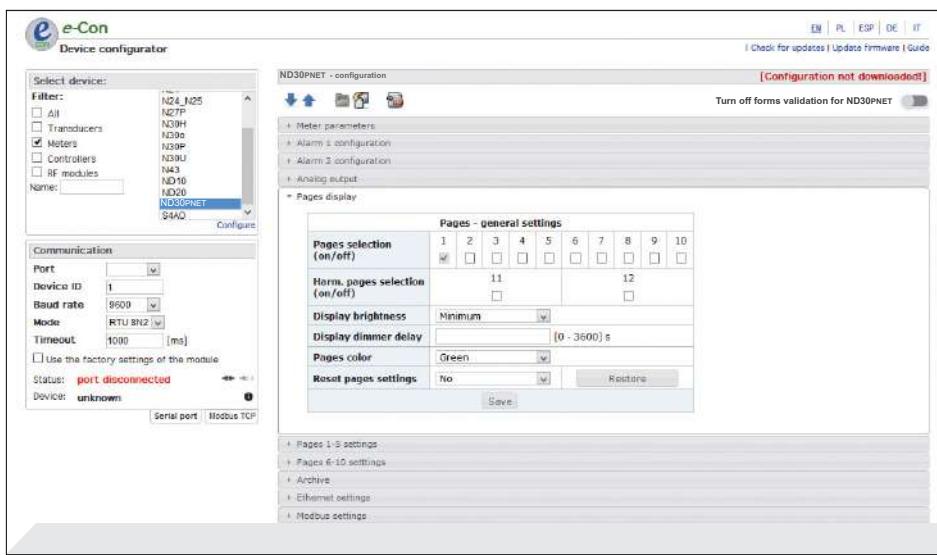

ability to configure and update ND30PNET  
with free eCon software  
(via RS-485)

\*- availability of feature depends on hardware  
version of ND30PNET

## ORDERING CODE

ND30PNET	X	X	X	XX	X	X
<b>Input voltage (phase/phase-to-phase) Un:</b>						
3 x 57.7/ 100 V, 3x 230/ 400 V	1					
3 x 110/ 190 V, 3 x 400/ 690 V	2					
<b>Additional outputs /inputs:</b>						
2 relays	1					
2 relays, 1 analog output, 2 inputs PT100	2					
2 relays, 1 analog output, 2 binary inputs (galvanically isolated)	3					
<b>Supply:</b>						
85...253 V a.c., 90...300 V d.c.	1					
20...40 V a.c., 20...60 V d.c.	2					
<b>Version:</b>						
standard		00				
custom-made*		XX				
<b>Language:</b>						
Polish/ English		M				
other*		X				
<b>Acceptance tests:</b>						
without additional quality requirements		0				
with an extra quality inspection certificate		1				
with calibration certificate		2				
acc.to customer's request*		X				

### Order example:

The code: **ND30PNET\_122100M0** means:

**ND30PNET** - meter ND30PNET

**1** - input voltage 3 x 57.7/ 100 V, 3x 230/ 400 V

**2** - 2 relays, 1 analog output, 2 inputs PT100

**1** - supply: 85...253 V a.c., 90...300 V d.c.

**00** - standard version

**M** - Polish/English language version

**0** - without additional quality requirements.

\* only after agreeing with the manufacturer

## SEE ALSO:



**ND40** - power network analyzer/ recorder



**RE92** - dual loop controller



**P30U** - universal transducer of temperature and standard signals



**KS31** - Digital synchronizing unit



**N43** - rail mounted 3-phase power network meter



**P43** - 3-phase transducer of power network parameters



**ND1** - analyser of network parameters



Current transformers from 5 A up to 6 kA

For more information about Lumel products  
please visit our website:

[www.lumel.com.pl](http://www.lumel.com.pl)

Join us at Facebook!

